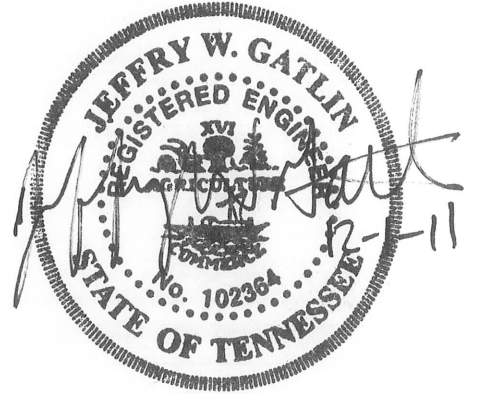# ADDENDUM NO. 1

TO

S.C.J.M. LAUNDRY UPGRADE – LL – 67
SHELBY COUNTY JUSTICE COMPLEX
201 Poplar Avenue
Memphis, Tennessee 38103

1 December 2011

1.   The attached page shall become Page 4 of Section 11110.

END OF ADDENDUM

2. Control System: Automatic preset timer and solenoid valve; w/ electronic control panel.
3. Lint filter: screen area 45 sq. Ft, stainless steel, auto cleaning w/ collection bag.

B. Model DLF-515 Dry Lint Filter:

1. Capacity: 15,000 cfm.
2. Screen area: 45 sq. Ft.
3. Screen change time: 15-30 min.
4. Compressed air: 40 gal @ 110 psi.
5. Ave. Static pressure: 0.25 wc
6. Electrical req.: 110-120v, 3 amp

C. Equalizer Blower And Control

1. Function: minimize static back pressure by measuring the static pressure and adjusting the assist fan to balance the system.
2. Static pressure range: 0.0" – 0.30" w.c.
3. Equalizer Components: Assist blower, variable frequency drive (vfd), pressure transmitter, pressure gage, pressure tip and tube w/ nema 12 wall mount enclosure.
4. Control system: includes controls for ccs lint filter and fan with push button controls.
5. Barometric damper: sized per manufacturer according to application.

PART 3: EXECUTION

3.01   Examination

A. Do not begin installation until substrates have been properly prepared.

B. If substrate preparation is the responsibility of another installer, notify architect of unsatisfactory preparation before proceeding.

3.02   Preparation

A. Clean surfaces thoroughly prior to installation.

B. Prepare surfaces using the methods recommended by the manufacturer for achieving the best result for the substrate under the project conditions.

3.03   INSTALLATION

A. Install in accordance with manufacturer's instructions.

B. system startup and commissioning: arrange for a local manufacturer's representative to inspect machines prior to startup and operation.

3.04   Protection

A. Protect installed products until completion of project.

B. touch-up, repair or replace damaged products before substantial completion.

END OF SECTION